




Two of the Fourteen Fire Alarm Workstations in the Fire Alarms Laboratory. These are Notifier Addressable Fire Alarm Panels with Control, Zone and Monitor Modules, Conventional and Addressable Initiating Devices and Strobe Notification Appliance Circuits.



Notifier Addressable Fire Alarm Panels with IDC and NAC and attached Initiating Devices and Notification Appliances. The upper Fire Alarm Panel is wired with Class A Circuits and the lower Fire Alarm Panel has identical devices connected to Class B Circuits.

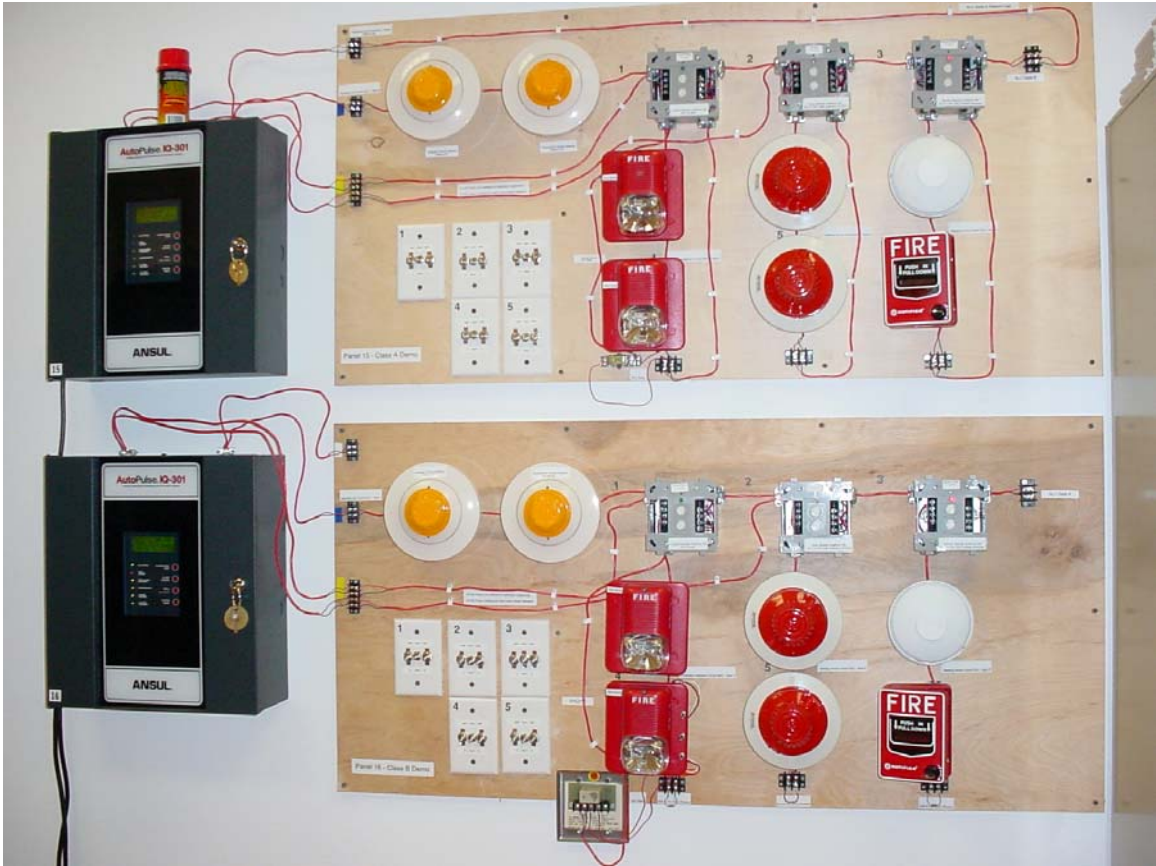

We do have a few antiques also.